

POWER LINE TYPOLOGIES AND ELF MEASUREMENT PROCEDURES

ABSTRACT

The issue of how to measure magnetic induction fields generated by various power line configurations, when there are several power lines that run across the same exposure area, has become a matter of interest and study within the Regional Environment Protection Agency of Friuli Venezia Giulia (ARPA FVG). In classifying the various power line typologies the definition of double circuit line was given: in this instance the magnetic field is determined by knowing the electric and geometric parameters of the line. In the case of independent lines instead, the field is undetermined. It is therefore pointed out how, in the latter case, extracting previsional information from a set of measurements of the magnetic field alone is impossible. Making measurements throughout the territory of service has in several cases offered the opportunity to define standard operational procedures.

M. Benes¹, M. Comelli¹, A. Bampo¹, R. Villalta¹

¹ Regional Environment Protection Agency of Friuli Venezia Giulia (ARPA FVG) Environmental Physics Via Tavagnacco 91 – 33100 Udine, Italy.

INTRODUCTION

Whether prolonged exposure to ELF magnetic fields generated by power lines has a significant impact on human health is still an open issue. Several evaluation studies carried out in laboratories concerning this frequency range have given obscure or difficultly interpretable effects, while others have evidenced significant effects from *in vivo* and *in vitro* experiments. Epidemiological studies have returned mixed results, and a recent evaluation of the combined results of the major studies conducted in this connection, shows a statistically significant correlation between childhood leukaemia and residential proximity to power lines (¹).

The concern to protect the framework of human life may legitimately lead to ensuring that anyone who proposes a decision has undertaken an in-depth a priori analysis of all the implications, advantages and disadvantages of the latter, calling upon all the scientific and technical knowledge of the day. Such a rule could be understood as the Principle of Precaution PP.

In Italy, regulations limiting exposure of the general public to electromagnetic fields are set under a framework law (²). This was intended to set out the basic principles for promotion of scientific research for the assessment of long-term side-effects and adopting precautionary measures in compliance with the PP provided for by Paragraph 2 of Article 174 of the Treaty on European Union.

Cautionary permissible exposure limits, attention values and quality objectives, for the general public, are set out in a regulation under the framework law (³) as follow. In case of exposure to electric and magnetic fields generated by power lines, the following exposure limits must not be exceeded: 100 μT for the magnetic induction field and 5 kVm^{-1} for the electric field strength, both expressed as rms values (short-term effects).

As a cautionary measure to protect against any possible long-term effects that might be related to power frequency (50 Hz) magnetic fields, an attention value of 10 μT is adopted in children playgrounds, residential dwellings, school premises, and in areas where people are staying for 4

hours or more per day. The attention value is the median of values recorded over 24 hours, under power line normal operational conditions.

In designing new power lines as well as in planning developments in the proximity of existing electric power lines, for the categories mentioned above, a quality goal of 3 μT is adopted for the purpose of progressively minimising exposures. Also this limit is intended as described above.

Among the institutional tasks of the ARPA FVG there is also that to carry out the measurements of magnetic induction fields in the proximity of power lines. In order to meet the requirements of the Italian legislation, the information concerning the induction value – which is the median value over 24 hours under normal working conditions of the power line – must be acquired through measurements. CEI ⁽⁴⁾ rules and IEEE ⁽⁵⁾ standard procedures, however, only supply qualitative indications on how to carry out measurements, without determining the measurement duration as well as not refer to more complex cases.

After giving a short introduction to electrotechnics, this work will define the typologies of lines that can be found in the area of service. A series of performed measurements concerning both a trivial situation and more complex cases will be presented as well as the procedures adopted by the ARPA FVG.

A SHORT OUTLINE OF ELECTROTECHNICS

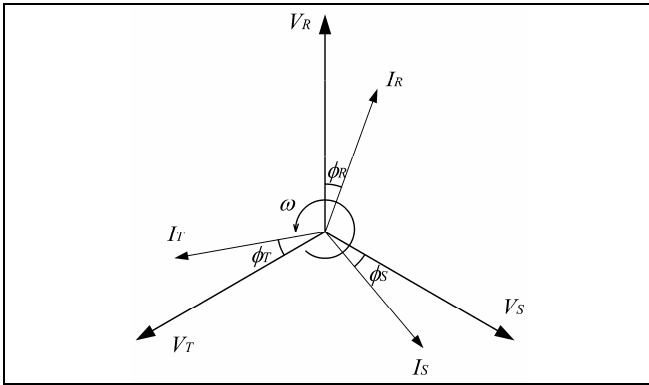


Figure 1. Phasors V - I diagram.

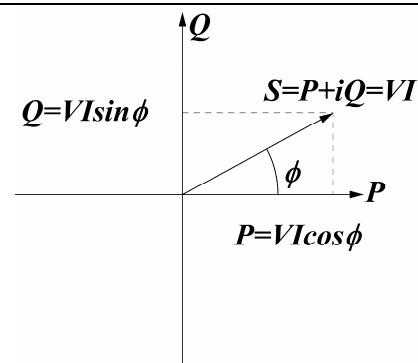


Figure 2. Scalar P - Q diagram.

The plants considered in this work are three-phase alternating tension and current system transmission and distribution power lines operating at industrial frequency (50 Hz in Italy).

The tension is represented by phasor $e^{i(\omega t + \theta_k)}$, where ω is the angular speed which corresponds to a rotation frequency of 50 Hz, and the three phase angles θ_k can assume the values 0° , 120° and 240° . The phases are usually indicated with R , S and T . The conventions adopted in the following part of this work are shown in Figures 1 and 2. Currents and tensions are generally out of phase of an angle ϕ , as shown in the conventional phasor diagram in Figure 1. In the instance of currents of the same intensity ($I_R = I_S = I_T$) the circuit is defined balanced, in the instance of identical phase shifts ($\phi_R = \phi_S = \phi_T$) it is defined symmetric.

The conditions outlined below will be assumed as valid, as generally fulfilled when High Voltage (HV, 132 kV) and Very High Voltage (VHV, 220 e 380 kV) (Voltage values of the power lines in Friuli Venezia Giulia), power lines are concerned. In the hypothesis of HV and VHV balanced lines the earth wire current is null.

In Figure 2, which, for the sake of simpleness, refers to a monophasic case, S indicates the apparent power, P the active power, Q the reactive power, V the line-to-line voltage and I the line current. When the load is capacitive, the current has a phase lead compared to the voltage, and Q is conventionally assumed as negative. Whereas, when the load is inductive, the current has a phase

lag compared to the voltage and Q is assumed as positive. It is also possible to demonstrate $P = \sqrt{3}VI \cos \phi$ and $Q = \sqrt{3}VI \sin \phi$ in the case of a three-phase power line.

In the case of VHV power lines, P and Q are measured at the power-conversion stations. The sign of P depends on the phase shift amplitude between current and voltage (it is positive when $|\phi| < 90^\circ$, negative when $|\phi| > 90^\circ$), and it can be correlated to the power flow (and therefore to the energy flow). Current flow, instead, in this specific case of alternate current, has no physical meaning, as erroneously indicated in ⁽⁶⁾.

DEFINITION OF POWER LINE TYPOLOGIES

The various power line typologies which can be found on the service area will, now, briefly be outlined. The adopted terminology admittedly refers to aerial lines, although, the concepts are also pertinent for underground cables.

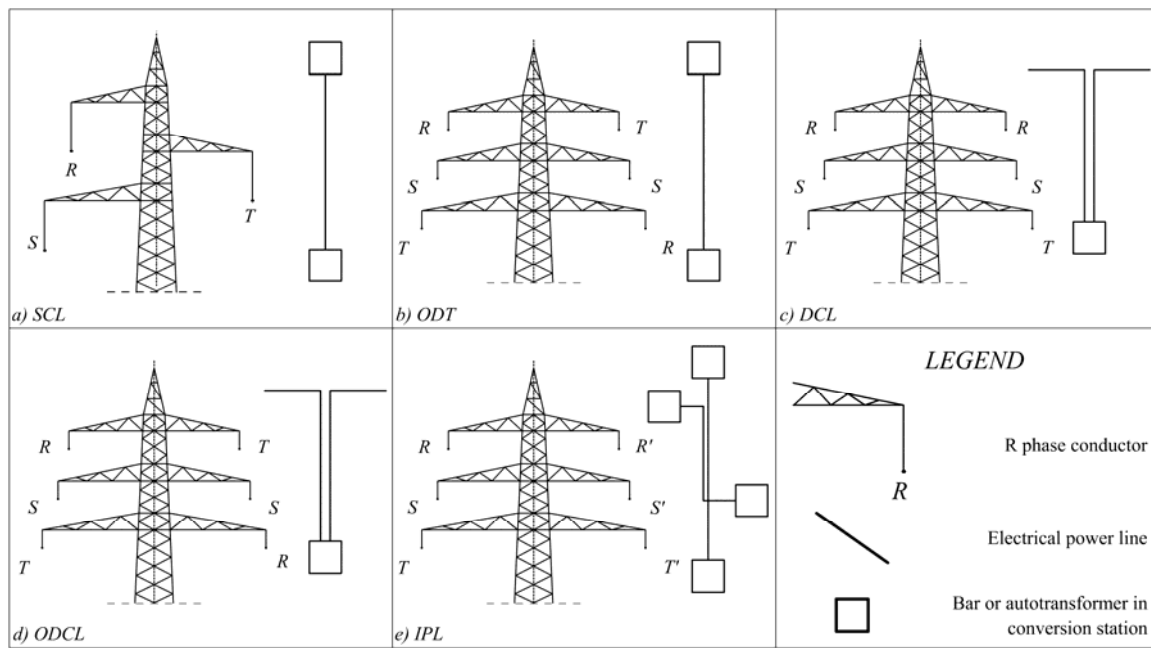


Figure 3. Schematic representation of power line typologies.

Single-Circuit Line SCL: the pylons carry one single conductor per phase (or each phase is divided in a group of cables, and in this case we refer to twin conductors, triple conductors, etc.), (Figure 3a).

Split-Phase Line SPL: that where some of the phases are shared among different conductors, which therefore sustain a lower load. If the three phases are split and set in an antisymmetric manner, the generated field is consequently minimized (optimized double tern-ODT configuration), (Figure 3b).

Double-Circuit Line DCL: it is a system made up of two distinct power lines, which share the same pylons for a section of their length and have homologous (i.e. at the same phase: R, S o T) conductor voltages out of phase of a known quantity: in order to fulfil this condition, the homologous conductors must end on the same bar in transformation power station (in the case of same nominal voltage) or respectively to the primary and secondary winding of an autotransformer (in case of distinct nominal voltages), (Figure 3c).

Optimized Double Circuit Line ODCL: a kind of double-circuit line, which is characterised by a particular disposition of the phases in order to minimize the magnetic field generated ⁽⁷⁾, (Figure 3d).

Independent Power Lines IPL: power lines whose conductors derive from and end at different power stations. In this case, it is not possible to formulate any hypotheses on a relation between the phase shifts concerning the homologous conductors, (Figure 3e).

The distinction between DCL and ODT has been introduced to make the following exposition more clear; the DCL is made up of two power lines having different currents and voltage typologies (therefore different phase shifts ϕ), while the ODT is a line having only one current and the same ϕ for homologous conductors. The condition required to optimize a DCL, or in general a system made up of more lines, is that the homologous voltages have a determined phase shift. This condition is not fulfilled in the case of IPL.

The phase shifts between the homologous voltages of two lines having different nominal voltage are known when also the type of autotransformer used in the conversion station is known. For example, a “YNa0” (“Y” indicates the star connection of the conductors, “N” that the neutral conductor is accessible, “a” that input and output windings are autoconnected, and “0” no phase shift between the input and the output voltage) autotransformer does not create any phase shift between input and output voltages. Therefore, if two or more lines of this type run across the same site, the situation is determined by knowing V, P and Q, and it is then possible to optimize the system of lines in order to obtain an ODCL.

Licitra et al. ⁽⁶⁾ take in consideration the case of two independent lines, which do not end at the same conversion station and have no electric characteristic in common. The lines in consideration are not in phase, and the phase shift between homologous conductors currents, hereinafter referred to as $\Delta\phi$, in time changes in an unpredictable manner. The said authors state that the sense of the energy flow is supplied by the lines owner, nevertheless, these data cannot be used to evaluate $\Delta\phi$, and therefore to extrapolate the alleged conclusions, precisely because they are independent lines. Energy flow sense has an affective meaning only if there is a common reference frame, for the two lines, as could be the voltages shown in Figure 1. This reference frame does not exist in the case of independent lines: the two voltage sets (and consequently the current sets) are uncorrelated, out of phase by an unknown and unfixed amplitude, therefore, can not be obtained by the line owner even having the measures of P and Q. In the following part of the present work, a similar argumentation to ⁽⁶⁾ will be discussed but it will treat the case of a DCL where the system is altogether determined by the reading of V, P and Q.

EXPERIMENTAL ASPECTS

Before measuring a magnetic induction field proximate to power lines, it is necessary to individuate the specific cases they fall under. When more power lines run across a same site, it is necessary to get information from the line owner on the existing relationship between the homologous voltages, which is, if the lines are independent or if the voltages have fixed phase shifts. This information is essential to correctly interpret the results of the measurements, or to calculate statistical predictions starting from the set of acquired data. The readings carried out close to single, double and triple circuit lines are presented in the next paragraph.

Single circuit line: in this case the magnetic induction field is proportional to the circulating current (according to Biot-Savart’s law), so it is sufficient to carry out a spot measurement, as described further on. Knowing the transiting current at the measurement time, it is possible to calculate the field in that specific point in every other moment of the current time chart. Figure 4 shows the relationship between line current intensity and measured magnetic induction in proximity to a 380 kV single line (the n. 356, Planais-Redipuglia). The measurement was carried out during a three day period by means of a PMM 8055S continuous area monitor station, powered by photovoltaic cells and remotely queried by using a GSM modem. The field meter was placed close to the line and the probe fixed at 1.5 m away from the ground, and the acquisition time set at 1’ in AVG mode. Arithmetic average result was chosen because the induced currents in the human body

are proportional to the field intensity, and not to the power for which the root-mean-square (RMS) would have been chosen.

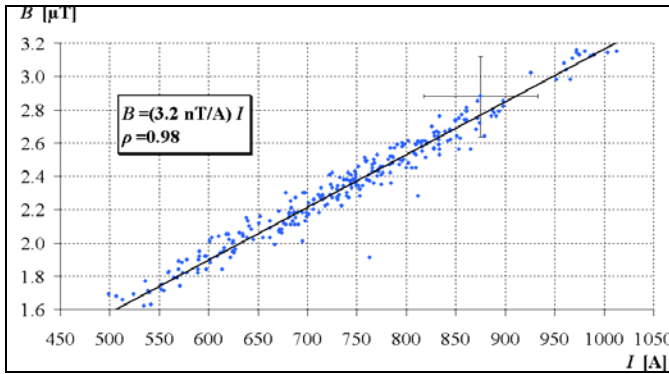


Figure 4. Relationship between measured induction and line current for a single line case (n. 356, 380 kV).

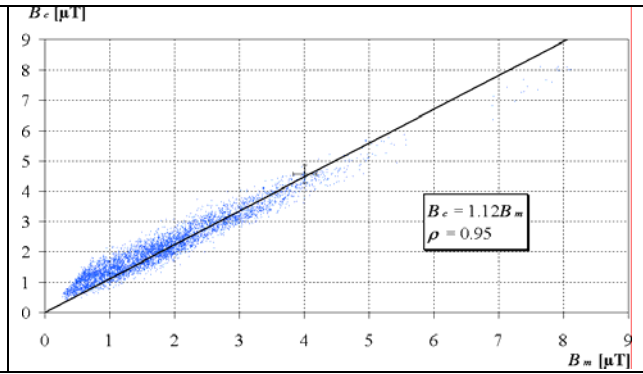


Figure 5. Relationship between induction measured (B_m) in proximity to a double line and that calculated by *Phidel*[®] (B_c).

Considering an error of 6.6% on the data supplied by the owner and a measurement error of 8.4%, the result is a reduced chi-square with 272 degrees of freedom $\tilde{\chi}_{272}^2 = 0.08$: this value does not allow to reject the proportionality hypothesis. Collected and fitted data are shown in Figure 4. The computation of the efficient magnetic induction field was performed by *Phidel*[®], an innovative software ⁽⁷⁾, once the electric and geometric data referring to the considered power line were supplied by the owner.

In the case of split-phase lines, the situation does not change, as the phases are simply carried by a larger number of conductors.

Double circuit line: measurements were carried out close to two 380 kV power lines (347 Planais-Salgareda and 356 Planais-Redipuglia), at five kilometers from conversion station, using the already mentioned field meter at the same settings. The two lines reach the same bar at the conversion station, so the homologous voltages are in phase: the magnetic induction value in a specific point therefore can be obtained by the measures of V, P and Q, whose values are recorded every 15 minutes.

In order to calculate the value of the measured magnetic induction field, the above described convention, used to determine the phase shift between the currents of the two lines was taken in account. Using that assumption, the area monitor station measurements on a 60 days basis and the computation performed by *Phidel*[®] were compared. Figure 5 shows the relationship between the measured field and the results returned by the software. To test the validity of *Phidel*[®], the results were compared with experimental measurements, obtaining the value of the reduced chi-square with 5182 degrees of freedom $\tilde{\chi}_{5182}^2 = 0.6$, that does not allow to reject the hypothesis on the validity of the software.

In ⁽⁶⁾, the authors' purpose is to find a way to determine the field produced by a multi-line system, assuming a linear dependence between the induction and the current of the line closest to the point of measurement, while the field created by the remaining ones is considered as a constant background.

Taking in consideration the above described measurements, in the following passage it will be demonstrated that the field-trend in function of the current of each of the two lines presents features that do not accord with the said hypothesis.

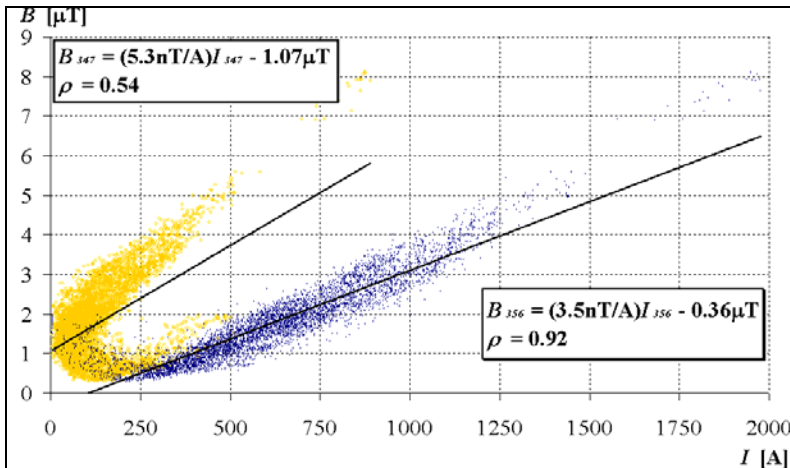


Figure 6a. Magnetic induction in function of current for lines 347 (orange dots) and 356 (blue dots).

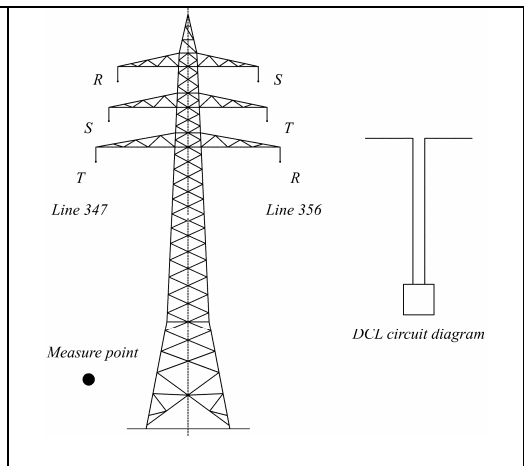


Figure 6b. Disposition of the phases on a pylon of the 347-356 DCL and relative circuit diagram.

According to Figure 6, in which the collected data are shown, it is not possible to set a relationship as $B = B_0 + kI$ with $B_0 > 0$: in one case there is an absence of linearity as evidenced by the orange dots, in the other a “negative background” as shown by the blue dots.

Consequently, in order to determine the field value in proximity to several power lines, it is necessary to consider the relative phase shift between the currents, and more superficial approximations can be due to a poor statistical data collection or to the particular geometry of the system, for which the effect produced by one line is predominant. In fact, in Figure 6a a measured magnetic field of 2 μT is generated by a current of about 100 A circulating in the 347 line combined with a current of about 750 A due to the 356 line. Figure 6b shows the sketch of a pylon head for the DCL in exam with the indication of the measure point. On the right side of the figure the circuitual scheme is displayed. It is possible to note the not-optimized phases disposition.

Triple circuit lines: the case of a 220 kV DCL (283 Monfalcone Z.I. - Redipuglia and 277 Redipuglia - Monfalcone Z.I. AL.) and of a 380 kV line (343 Monfalcone C. TE - Redipuglia) was taken in consideration. For a certain length, at five kilometers from the generating station, they run parallel and only a few meters distant from one another. The three lines come from the same conversion station, and a “YN_a0” autotransformer is placed in the midst of them. Also in this case, the system is fully determined by knowing V, P and Q, and the field can be calculated as in the previous case.

Independent lines: in the general case of independent lines, or when the readings of P and Q are not available, it is impossible – not even on the part of the line owner – to formulate any hypothesis on $\Delta\phi$ when the measurement is carried out, or also make a statistical prevision on the power flow directions in order to reproduce or to interpret the measurements. In these cases, the only possibility to extrapolate precautionary considerations on the intensity of a magnetic induction field is to resort to a computation of the worst phase configuration using *Phidel*[®] software, or over a long period continuously monitor the field from which extract statistical information.

CONCLUSIONS

The nomenclature related to the different line typologies has been made clear by defining the concept of double circuit line, and a measurement procedure set up starting from the simple case of the single circuit line, considering then that of a double circuit line, and finally taking in consideration a system of independent lines. In the cases where P and Q are not available, or when considering independent lines, it is evidenced how the aid of specific software computation can

become fundamental. The alternative is to resort to a continuous area monitor station. The purpose of the present study is to point out how inappropriate it is to hazard statistic previsions on independent lines starting from a mere measurement of magnetic induction.

ACKNOWLEDGEMENTS

A particular thanks goes to Mr. Giorgio Pangerc, for taking so much of his time to help the authors with the matters concerning autotransformer electrotechnics.

REFERENCES

1. Ahlbom A. *A pooled analysis of magnetic fields and childhood leukemia*. B . J. Cancer **83** (9) (2000)
2. Law 22 February 2001, No. 36 – *Framework law on the protection against exposure to electric, magnetic, and electromagnetic fields*. Official Gazzette of the Italian Republic, No. 55, (3 July 2001).
3. Decree of the President of the Council Of Ministers 8 July 2003 – *Establishment of exposure limits, attention values, and quality goals to protect the population against power frequency (50 Hz) electric and magnetic fields generated by power lines*. Official Gazzette of the Italian Republic, No. 200, (29 August 2003).
4. CEI 211-6 *Guide for the measurement and the evaluation of electric and magnetic fields in the frequency range 0Hz – 10 kHz, with reference to the human exposure*. (2001)
5. IEEE *Standard procedures for measurement of power frequency electric and magnetic fields from AC power lines*. **644** (1994).
6. Licitra G., Colonna N. and Chiari C., *Evaluation of long term exposure to the magnetic field produced from power lines*. Radiation Protection Dosimetry Vol. **97**, No 4, pp. 401-404 (2001).
7. Comelli M., Bertocchi L., Benes M. and Villalta R.. *Analisi, modelli previsionali e valutazione di impatto ambientale di campi di induzione magnetica generati da linee elettriche ad altissima tensione*. Università degli Studi di Trieste, Facoltà di Scienze Matematiche Fisiche e Naturali, Corso di Laurea Specialistica in Fisica (Anno Accademico 2003-2004).